



DUPLEX 240V CONTROL PANEL
ENCLOSURE SUBPANEL LAYOUT

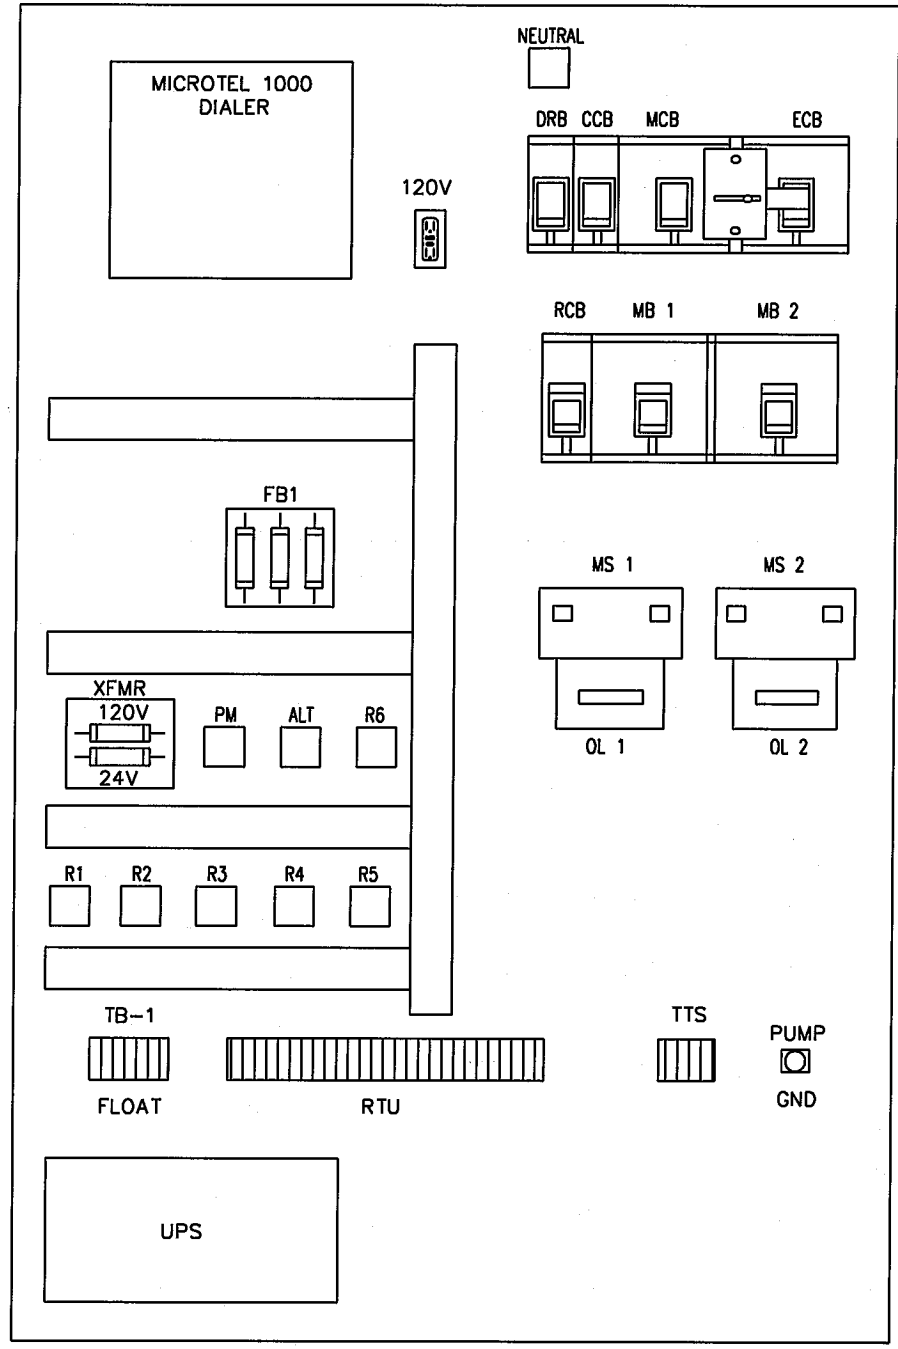

DUPLEX CONTROL PANEL
ENCLOSURE DEAD FRONT LAYOUT

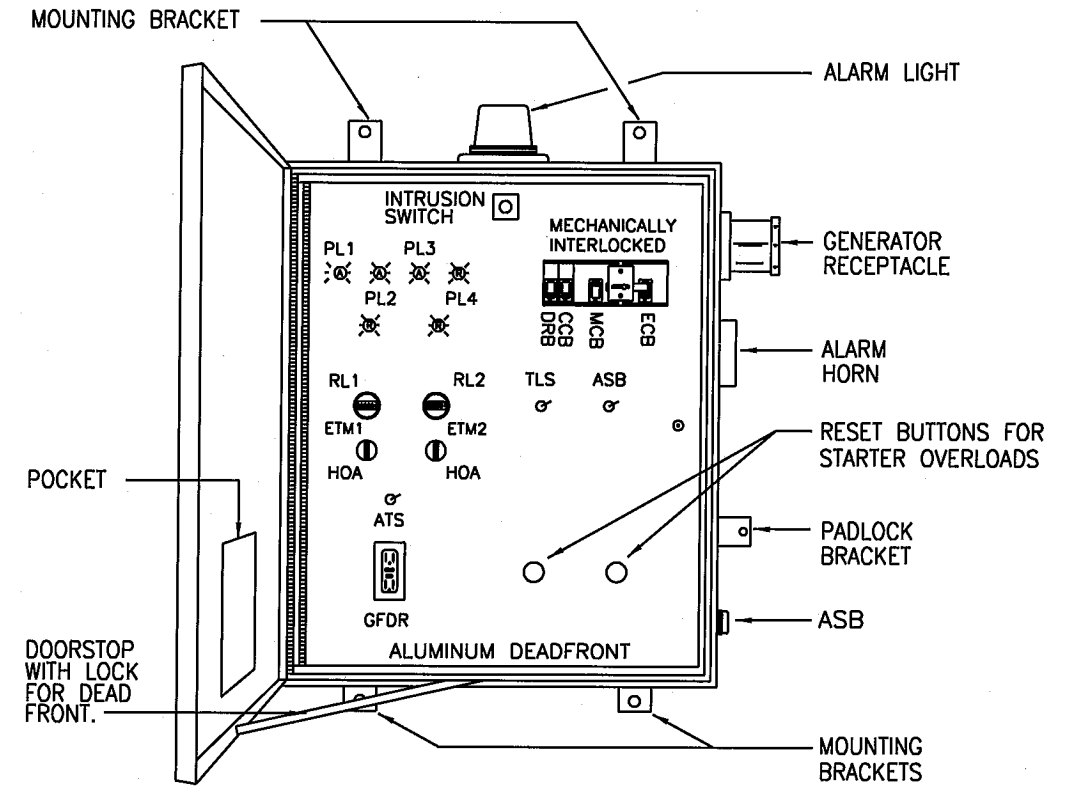

NOTES:

1. OUTER BOX SIZE SHALL BE A MINIMUM OF 30"W X 42"H X 12"D OR AS APPROVED BY THE CITY.
2. FOR STATIONS WITH PUMPS RATED 20 HP OR GREATER, OUTER BOX SIZE SHALL BE 30"W X 48"H X 12"D AND SHALL HAVE 2 LATCHES ON THE DEAD FRONT.
3. DRAWINGS SHALL BE REVISED FOR STATIONS WITH PUMPS RATED GREATER THAN 47 HP AND SUBMITTED TO THE CITY FOR APPROVAL.
4. PROVIDE EQUIPMENT FOR SCADA CONTROL CONNECTION.
5. ALARM LIGHT, HORN, SILENCE BUTTON AND GENERATOR RECEPTACLE ARE FOR VISUAL PURPOSES ONLY, EXACT LOCATION TO DETERMINED BY CITY.
6. THE OUTER DOOR SHALL INCLUDE A 3-POINT LATCH AND STAINLESS STEEL DOOR HANDLE AS MANUFACTURED BY HOFFMAN OR APPROVED EQUAL.
7. CONTRACTOR TO INSTALL FUTURE SCADA CONTROL BOX MOUNTED BACK SIDE OF CONTROL PANEL. USE 3R.SS 24" x 24" x 10" STAINLESS STEEL ENCLOSURE.

THESE DETAILS ARE PROVIDED ONLY TO ASSIST IN THE DESIGN PROCESS. ALL DESIGNS SHALL BE IN ACCORDANCE WITH THE SPECIFIC ARTICLES AND SECTIONS OF THE CITY OF OCOEE'S MOST CURRENT UTILITIES SPECIFICATIONS. IT IS THE ENGINEER'S RESPONSIBILITY TO OBTAIN AND USE UPDATED VERSIONS OF THESE DETAILS SHOULD THEY BECOME AVAILABLE FROM THE CITY.

NO.	DATE	DESCRIPTION	BY

**CITY OF OCOEE
UTILITIES DEPT.**

1800 A.D. MIMS RD, OCOEE, FLORIDA 34761
P 407-905-3100 F 407-656-7416 www.ci.ocoee.fl.us

**STANDARD
UTILITIES
DETAILS**

**240 DUPLEX CONTROL PANEL
FRONT AND SUBPANEL LAYOUTS**

SCALE:	N/A
DATE:	12/06
PAGE NO.:	4a
OF	6