240 LIFTSTATION CONTROL PANEL INSTALLATION DETAIL

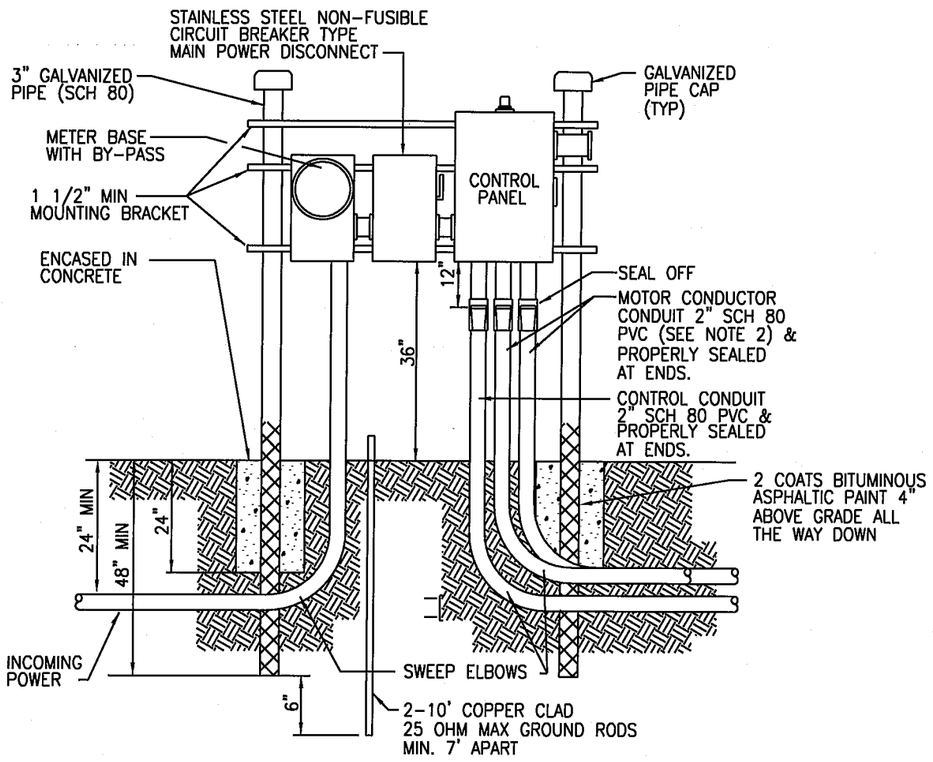

NOTES:

1. DRAWING IS SHOWN FOR 230 VOLT POWER SUPPLY.
2. POWER SUPPLY SHALL BE UNDERGROUND ON THE LIFT STATION SITE AND SHALL BE 3 PHASE FROM A 3 PHASE SOURCE ONLY.
3. PROVIDE TELEPHONE SERVICE LINE.
4. ALL WIRING BETWEEN FLOATS & CONTROL SHALL BE CONTINUOUS.
5. CONTROL PANEL SHALL BE NON-FUSIBLE STAINLESS STEEL

480 LIFTSTATION CONTROL PANEL INSTALLATION DETAIL

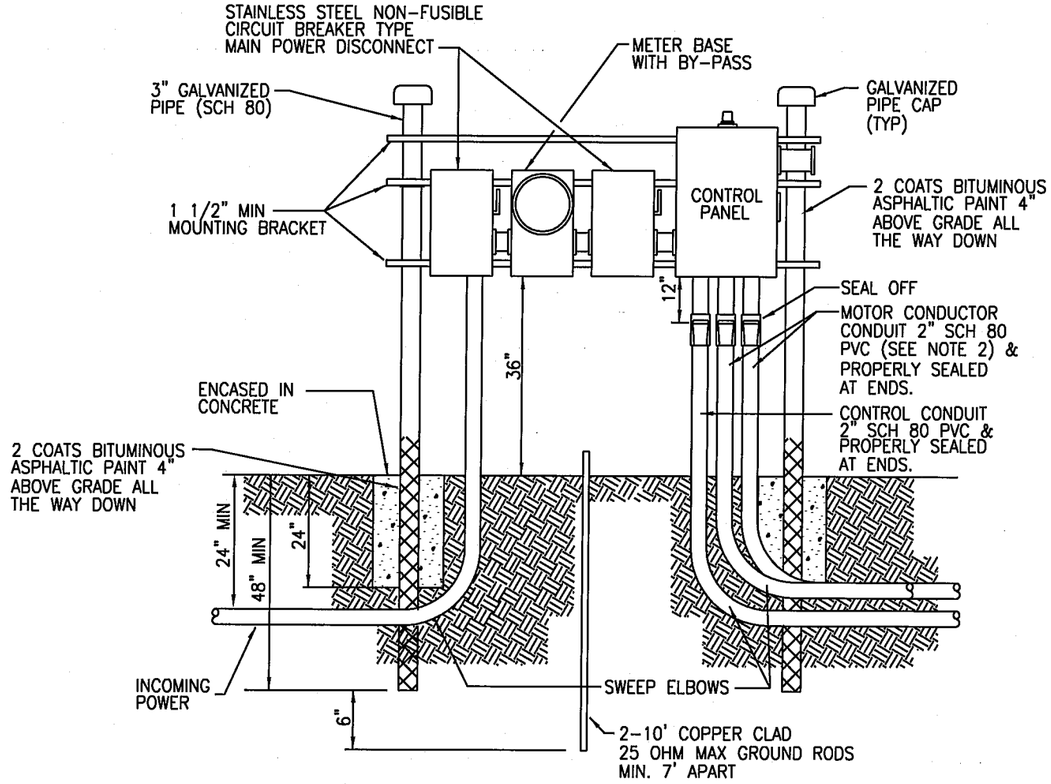

NOTES:

1. DRAWING IS SHOWN FOR 480 VOLT POWER SUPPLY.
2. POWER SUPPLY SHALL BE UNDERGROUND ON THE LIFT STATION SITE AND SHALL BE 3 PHASE FROM A 3 PHASE SOURCE ONLY.
3. PROVIDE TELEPHONE SERVICE LINE.
4. ALL WIRING BETWEEN FLOATS & CONTROL SHALL BE CONTINUOUS.
5. CONTROL PANEL SHALL BE NON-FUSIBLE STAINLESS STEEL

THESE DETAILS ARE PROVIDED ONLY TO ASSIST IN THE DESIGN PROCESS. ALL DESIGNS SHALL BE IN ACCORDANCE WITH THE SPECIFIC ARTICLES AND SECTIONS OF THE CITY OF OCOEE'S MOST CURRENT UTILITIES SPECIFICATIONS. IT IS THE ENGINEER'S RESPONSIBILITY TO OBTAIN AND USE UPDATED VERSIONS OF THESE DETAILS SHOULD THEY BECOME AVAILABLE FROM THE CITY.

REVISIONS

NO.	DATE	DESCRIPTION	BY

CITY OF OCOEE
UTILITIES DEPT.
1800 A.D. MIMS RD, OCOEE, FLORIDA 34761
P 407-905-3100 F 407-656-7416 www.ci.ocoee.fl.us

STANDARD UTILITIES DETAILS

LIFTSTATION CONTROL PANEL DETAILS

SCALE: N/A
DATE: 12/06
PAGE NO: 2 OF 6