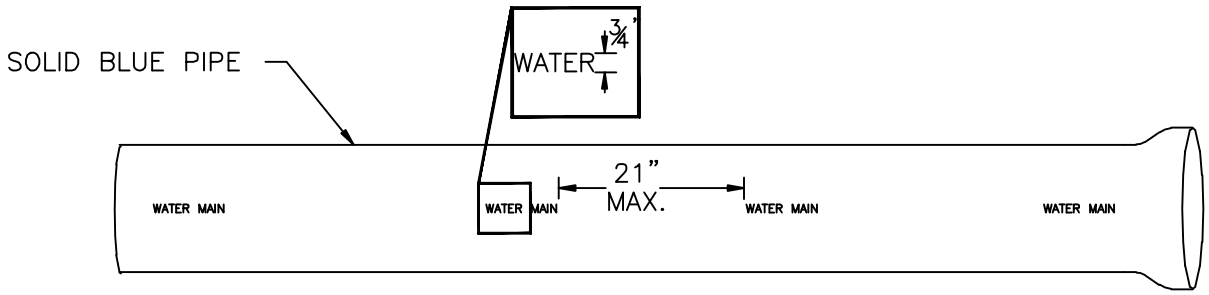

1. LETTERING SHALL APPEAR ON 3 SIDES OF THE PIPE AND RUN THE ENTIRE LENGTH OF THE PIPE.
2. LETTERING SHALL BE A MIN. OF 3/4" IN HEIGHT AND APPEAR ONE OR MORE TIMES EVERY 21" ALONG THE LENGTH OF THE PIPE.
3. LETTERING MUST BE PERMANENTLY IMPREGNATED INTO THE PIPE (IT MAY NOT BE STENCILED TO THE PIPES SURFACE).
4. LETTERING SHALL BE WHITE OR OTHER CONTRASTING COLOR.

WATER MAIN

NTS

TYPICAL METAL PIPE

2.5" – 4" PIPE – 3" TAPE IS CENTERED ALONG TOP HALF OF PIPE.

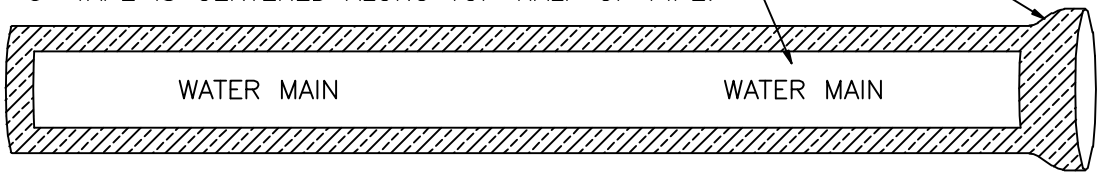

6" – 16" PIPE – 6"TAPE IS PLACED ALONG BOTH SIDES OF TOP HALF OF PIPE.

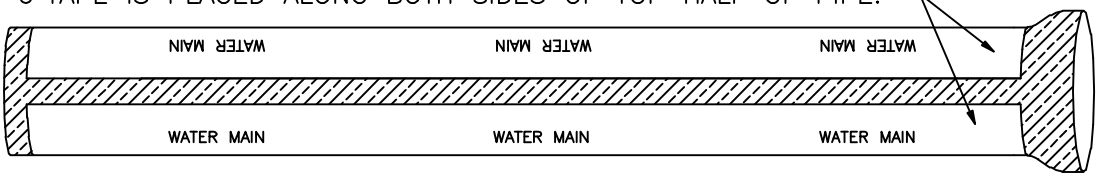

20" AND LARGER PIPE – TAPE IS PLACED ON BOTH SIDES OF THE TOP HALF OF THE PIPE WITH A THIRD STRIP CENTERED ALONG TOP HALF OF PIPE.

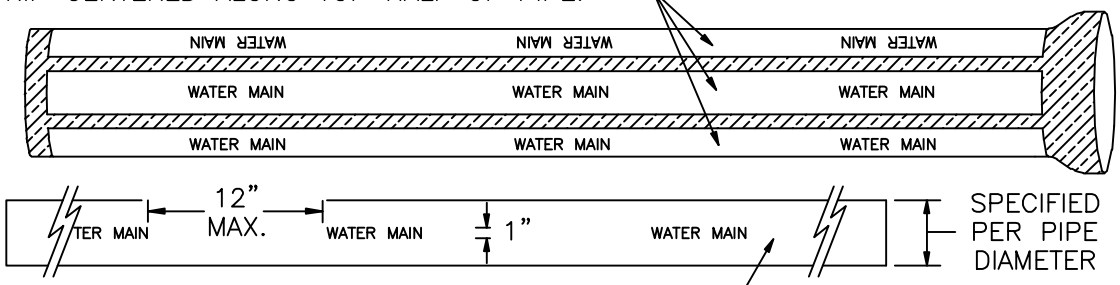

BLUE TAPE WITH WHITE OR OTHER CONTRASTING PERMANENTLY IMPREGNATED LETTERING SHALL BE USED. THE TAPE SHALL RUN FROM JOINT TO JOINT ALONG THE LENGTH OF THE PIPE.

METAL WATER MAIN WITH IDENTIFICATION TAPE

NTS

CITY OF OCOEE UTILITIES DEPARTMENT

PIPE IDENTIFICATION (POTABLE WATER)

DATE: NOV 2009	DWG: RPH	FIG: 111a