

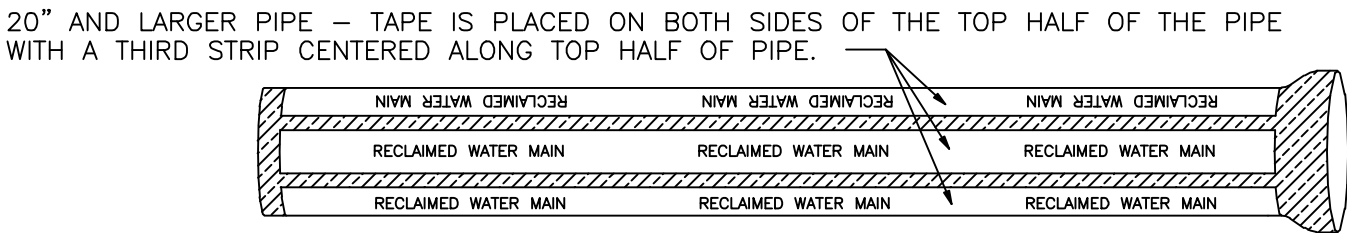
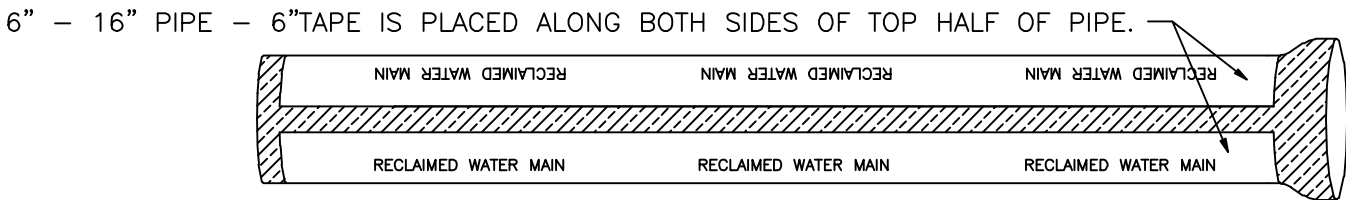


1. LETTERING SHALL APPEAR ON 3 SIDES OF THE PIPE AND RUN THE ENTIRE LENGTH OF THE PIPE.
2. LETTERING SHALL BE A MIN. OF 3/4" IN HEIGHT AND APPEAR ONE OR MORE TIMES EVERY 21" ALONG THE LENGTH OF THE PIPE.
3. LETTERING MUST BE PERMANENTLY IMPREGNATED INTO THE PIPE (IT MAY NOT BE STENCILED TO THE PIPES SURFACE).
4. LETTERING SHALL BE WHITE OR OTHER CONTRASTING COLOR.

RECLAIMED WATER MAIN

NTS

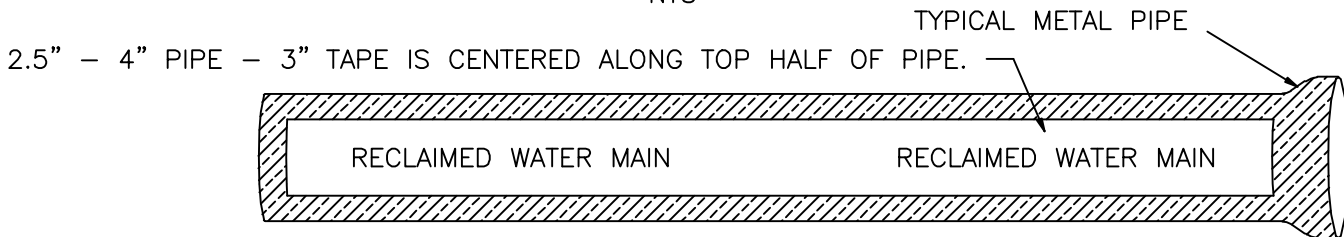

PURPLE TAPE WITH WHITE OR OTHER CONTRASTING PERMANENTLY IMPREGNATED LETTERING SHALL BE USED. THE TAPE SHALL RUN FROM JOINT TO JOINT ALONG THE LENGTH OF THE PIPE.

METAL RECLAIMED WATER MAIN WITH IDENTIFICATION TAPE

NTS

CITY OF OCOEE UTILITIES DEPARTMENT		
PIPE IDENTIFICATION (RECLAIMED WATER)		
DATE:	MAY 2009	DWG: PIRW
		FIG: 111